



System separator

I 0303 / I 0305

- ✔ Ideal protection for drinking water network
- ✔ Compact design
- ✔ Minimal maintenance
- ✔ With or without pressure reducer



HERZ Amaturen GmbH

A-1230 Vienna · Richard-Strauss-Strasse 22

Tel./Fax: +43 (0)1 616 26 31-0/-227, www.herz.eu



HERZ I 0303 / I 0305 System separator

I 0303 System separators prevent the back-pressuring, back-flowing or back-suction of contaminated water into the drinking water network. I 0305 expands the functions of the RPZ valve I 0303 additionally with a pressure regulator and a manometer.

Application area

RPZ back flow preventers prevent the back-pressuring, back-flowing or back-suction of contaminated water into the drinking water network in accordance with EN 1717. HERZ RPZ valves I 0303 or I 0305 belong to safety device type „BA“ and are therefore only suitable for use with liquid media up to category 4. Application areas are all areas in which a connection is established between the drinking water network and industrial water through fixed or flexible lines. Preferred application fields are softening, de-acidification and de-carbonisation plants. Furthermore, the RPZ valves can also be used in disinfection plants or upstream of chemical cleaning apparatus, in order to prevent the back-flowing of chemically contaminated water.

Functional description I 0303

The RPZ valve operates according to the three-chamber system, whereby a venting middle chamber is separated by a back-flow preventer between the intake and outlet chamber respectively. Under normal operating conditions, a pressure drop exists in the flow direction from one chamber to the next, which prevents a back-flow. When the pressure drop between the intake and middle chamber has dropped to 0.14 bar, the middle chamber will vent to a tundish. Any contaminated drinking water that is forced back at the back-flow preventer on the outlet side is then safely transported away via the differential pressure-controlled discharge valve and the tundish fitted on the outlet of the ventilation hole.

Functional description I 0305


Refilling combination for the filling and top-up of heating systems. Expands the functions of the RPZ valve I 0303 additionally with a pressure regulator and a manometer. Furthermore, automation of the filling process is also possible.

Operation, maintenance


In order to obtain the desired back flow prevention, the function should be checked and tested every 6 months. It is additionally important that the individual parts of the system separator can be replaced under pressure at any time. In order guarantee this, it is possible to shut off and then maintain the RPZ valve with the help of the shut-off valves.

checked and tested every 6 months. It is additionally important that the individual parts of the system separator can be replaced under pressure at any time. In order guarantee this, it is possible to shut off and then maintain the RPZ valve with the help of the shut-off valves.

I 0303

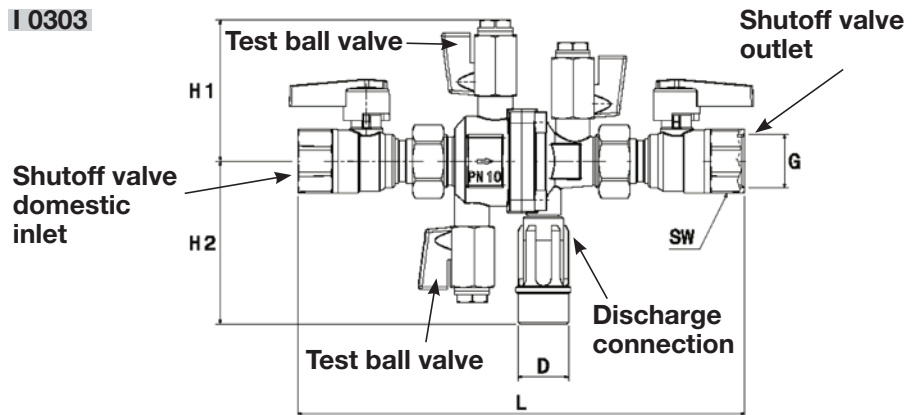

I 0305

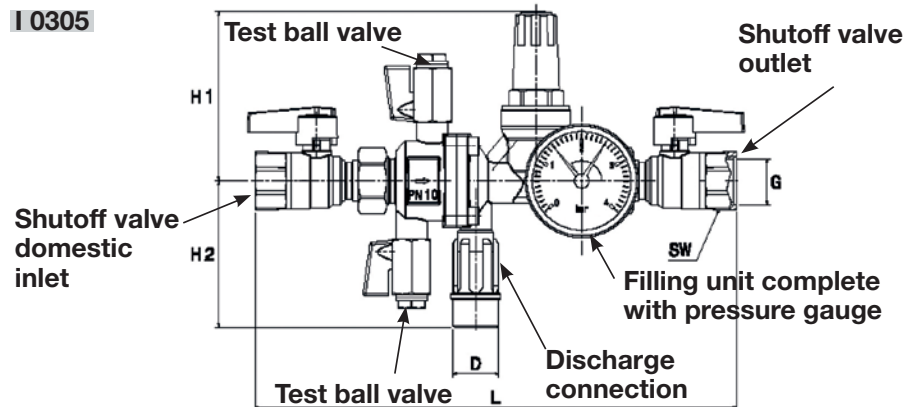

Order number	Dimension	G	L	D	H1	H2	SW	Medium	Nominal pressure	Temperature
I 0303 01	DN 15	1/2"	214 mm	25 mm	70 mm	80 mm	26 mm	Water	PN 10	65 °C
I 0303 02	DN 20	3/4"	220 mm	25 mm	70 mm	80 mm	32 mm	Water	PN 10	65 °C
I 0305 01	DN 15	1/2"	258 mm	25 mm	93 mm	80 mm	26 mm	Water	PN 10	65 °C
I 0305 02	DN 20	3/4"	264 mm	25 mm	93 mm	80 mm	32 mm	Water	PN 10	65 °C

HERZ Valves UK

Progress House, Moorfield Point
Moorfield Road, Slyfield Industrial Estate
Guildford, Surrey GU1 1RU
Tel.: +44 (0)1483 502211, Fax: +44 (0)1483 502025
E-Mail: sales@herzvalves.com
www.herzvalves.com

International Headquarters

HERZ Armaturen GmbH
Richard-Strauss-Str. 22, A-1230 Vienna, Austria
Tel.: +43 (0)1 616 26 31-0
Fax: +43 (0)1 616 26 31-227
E-Mail: office@herz.eu
www.herz.eu